

ZAKŁAD IZOLATORÓW ELEKTROTECHNICZNYCH BOPLAST Sp. z o.o.


Adres:

ul. B.Krzywoustego 1,
tel. +48 59 862 01 86;
www.boplast.pl

84-300 Lębork
tel. 516 198 886
e-mail: boplast@boplast.pl

POST INSULATORS * BUSHING INSULATORS * INSULATION PRODUCTS * SERVICES

Post insulator 7,2 kV type JO6-60.bp1

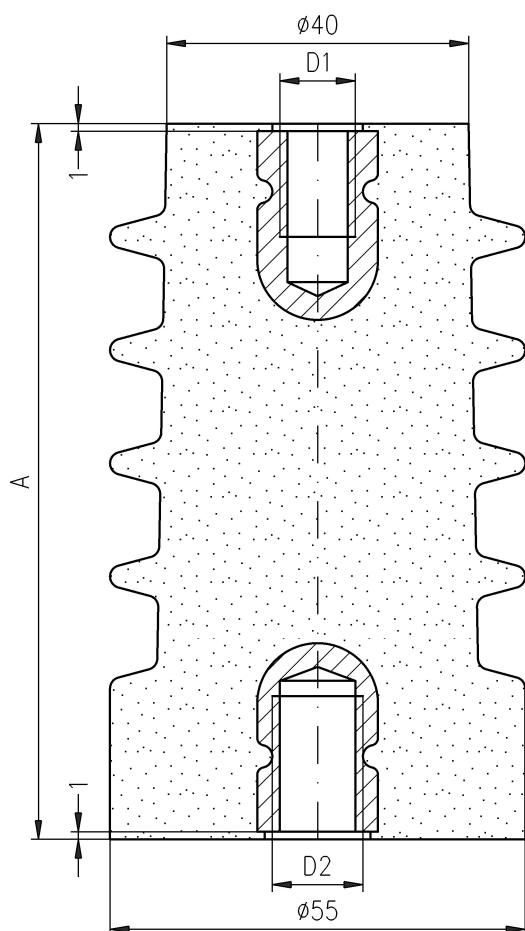

1. Insulator material:
epoxy compound
2. Parameters according to PN-IEC 60273
3. Tested according to PN-EN 60660
4. Requirements according to GOST 1516.1-76
5. Insulator meets requirements of F thermal class
6. Max screw tightening torque:
- M10 - 30 Nm
- M12 - 50 Nm
- M16 - 120 Nm
7. Indoor insulator
8. Possible version JOR6-60.bp1
with capacity insert

07	100	141	0,35	M10	M12
06	100	141	0,35	M12	M16
05	95	136	0,32	M10	M16
04	95	136	0,32	M10	M10
03	95	136	0,32	M12	M12
01	95	136	0,32	M10	M12
ver. dim.	A	B	C	D1	D2

	PN	GOST
Rated insulation voltage	7,2 kV	6 kV
Lighting impulse withstand voltage	60 kV	60 kV
Dry withstand alternate voltage (50Hz, 1 min)	28 kV	-
Test alternate voltage (50Hz, 5 min)	-	32 kV
Test alternate instantaneous voltage (50Hz, 1 kV/s)	-	36 kV
Bending strength Po	6 kN	
Creepage distance	B mm	
Weight	C kg	

Possible to make screws according to client's requirements.